

Errata to IEEE Guide for Dry-Type Transformer Through-Fault Current Duration

Sponsor

Transformers Committee

of the

IEEE Power Engineering Society

Correction Sheet

Issued 14 December 2006

Copyright © 2006 by the Institute of Electrical and Electronics Engineers, Inc. All rights reserved.
Published 2006. Printed in the United States of America.

This correction sheet may be freely reproduced and distributed in order to maintain the utility and currency of the underlying Standard. This correction sheet may not be sold, licensed or otherwise distributed for any commercial purposes whatsoever. The content of this correction sheet may not be modified. This information has been incorporated into second printing.

Page 4, Figure 2—Category II transformers, should be replaced with the following figure:

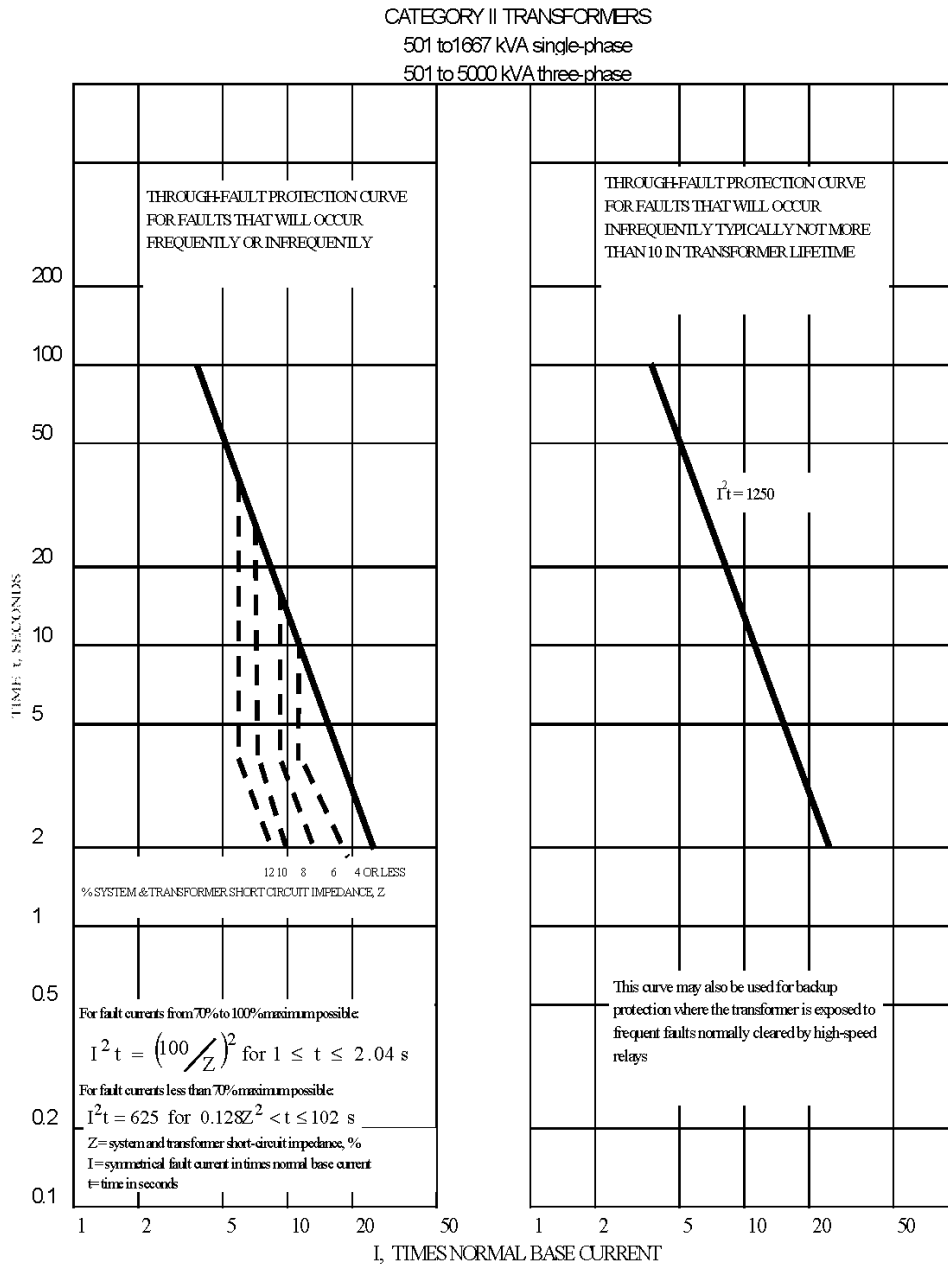


Figure 2—Category II transformers