

**IEEE Std 497-2002**  
(Revision of IEEE Std 497-1981)

# Errata to IEEE Standard Criteria for Accident Monitoring Instrumentation for Nuclear Power Generating Stations

Sponsor

**Nuclear Power Engineering Committee**

of the

**IEEE Power Engineering Society**


*Correction Sheet*

**Issued 20 February 2003**

Copyright © 2003 by the Institute of Electrical and Electronics Engineers, Inc.  
All rights reserved. Published 2003. Printed in the United States of America.


This correction sheet may be freely reproduced and distributed in order to maintain the utility and currency of the underlying Standard. This correction sheet may not be sold, licensed or otherwise distributed for any commercial purposes whatsoever. The content of this correction sheet may not be modified.

Page 5, Figure 1—Display channel, is incorrect. The figure should read as follows:

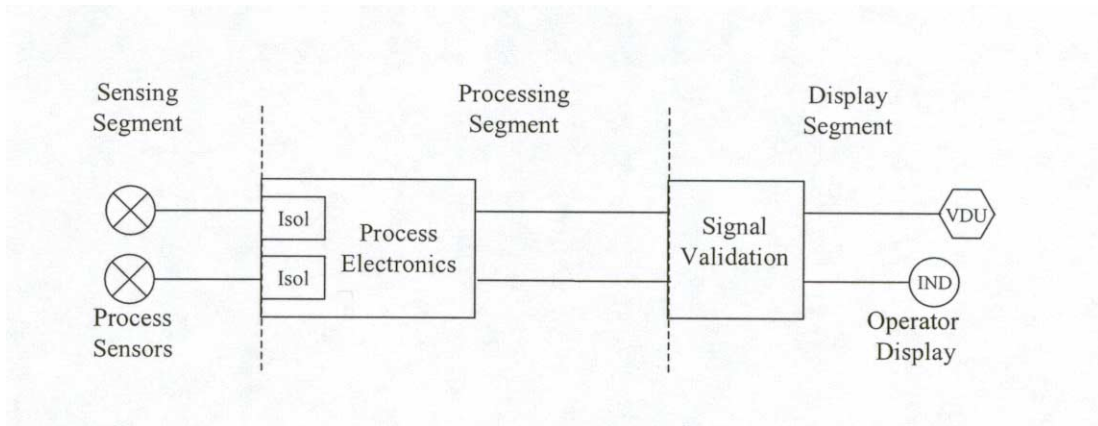

**Figure 1— Display channel**

Pg 16, Figure 2— Examples of monitoring channel displays, is incorrect. The figure should read as follows.

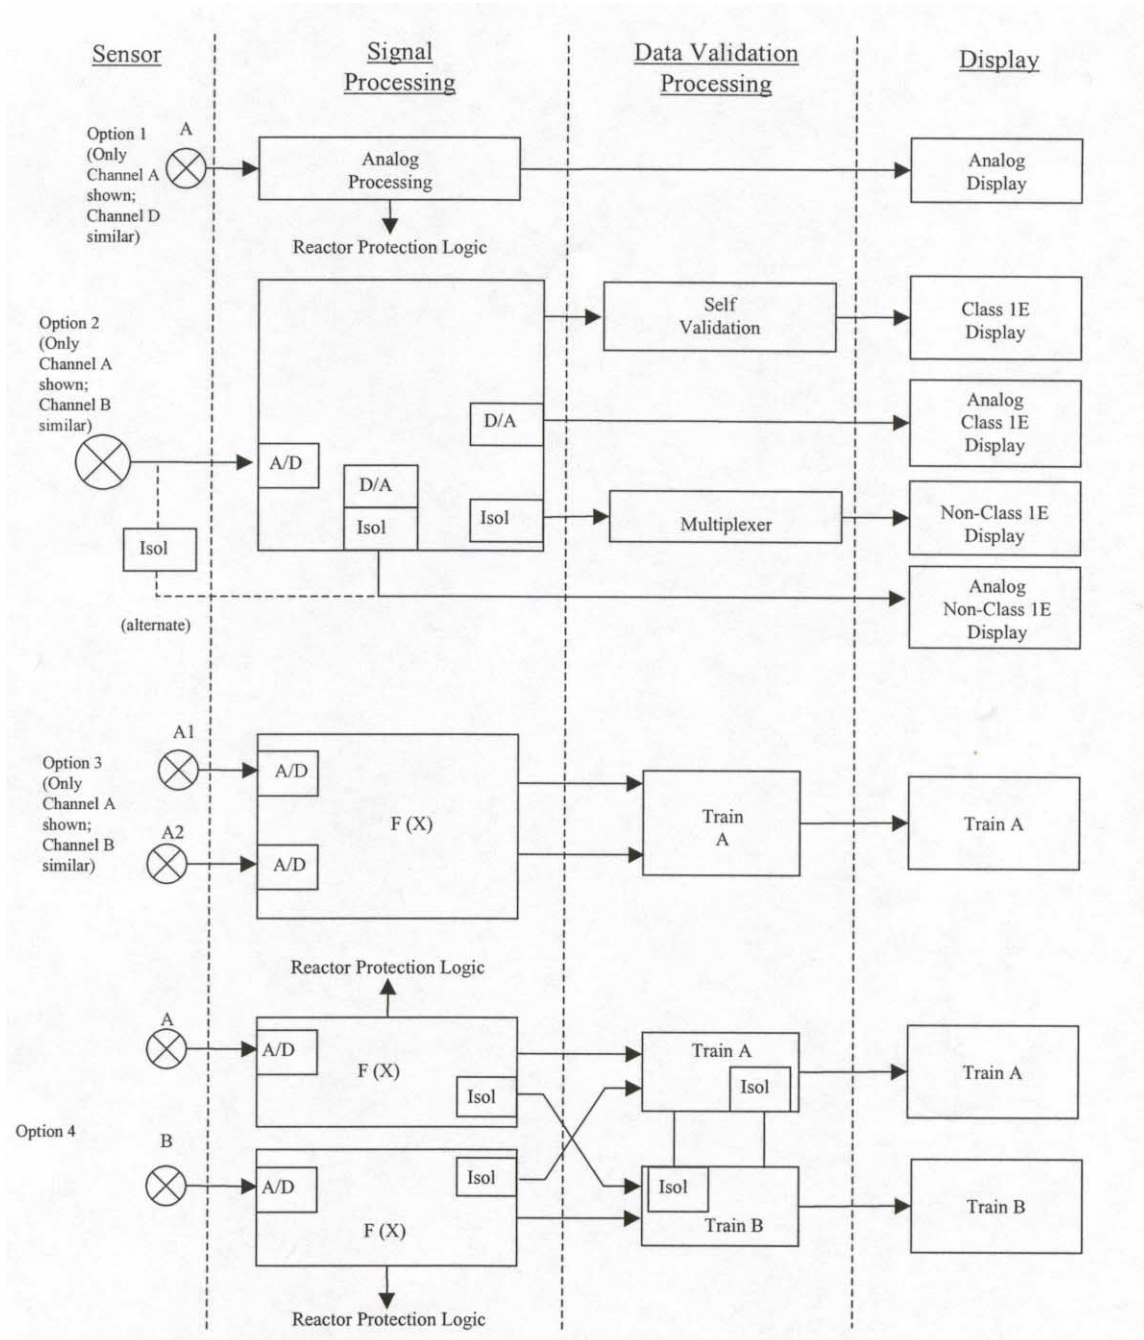

**Figure 2—Examples of monitoring channel displays**